


Installation Instruction

BPM1434

BYPASS Module for Recirculation

Installation kit includes:

- 1 x BPM assembly
- 2 x bracket
- 2 x Self drilling metal screws
- 12 x 10-32 machine screws
- 1 x extension harness

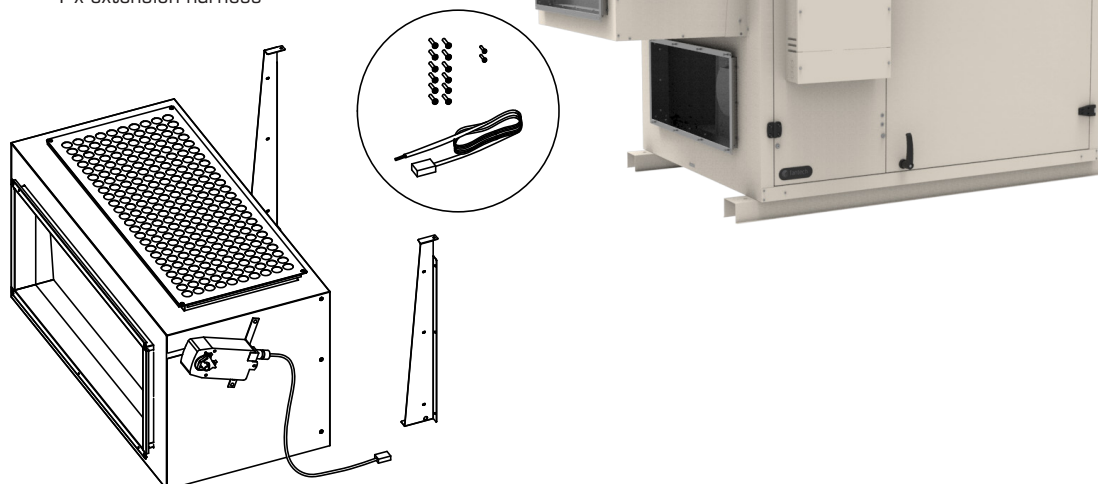

Your ventilation system should be installed in conformance with the appropriate provincial/state requirements or, in the absence of such requirements, with the current edition of the National Building Code, and / or ASHRAE's "Good Engineering Practices".


United States

10048 Industrial Blvd., Lenexa, KS, 66215
Tel.: 800.747.1762 • Fax: 800.487.9915

Canada


50 Kanalfakt Way, Bouctouche, NB, E4S 3M5
Tel.: 800.565.3548 • Fax: 877.747.8116

Fantech reserves the right to modify, at any time and without notice, any or all of its products' features, designs, components and specifications to maintain their technological leadership position.
Please visit our website www.fantech.net for more detailed technical information.

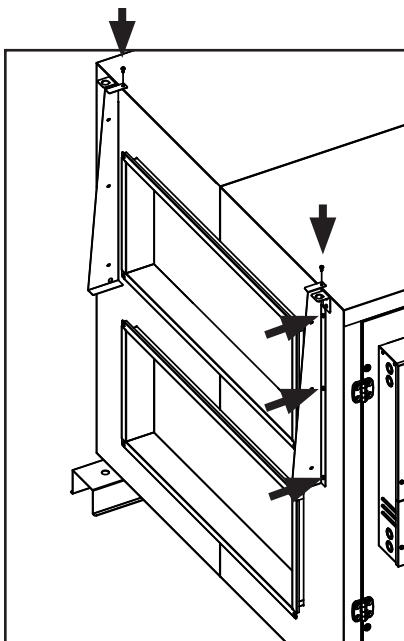


STEP 1

Install the left and right brackets
Install the bracket using three 10-32 machine screws in the nutserts pre-installed in the cabinet of the unit. Using the self drilling screw secure the top of the bracket. Repeat for the other bracket.

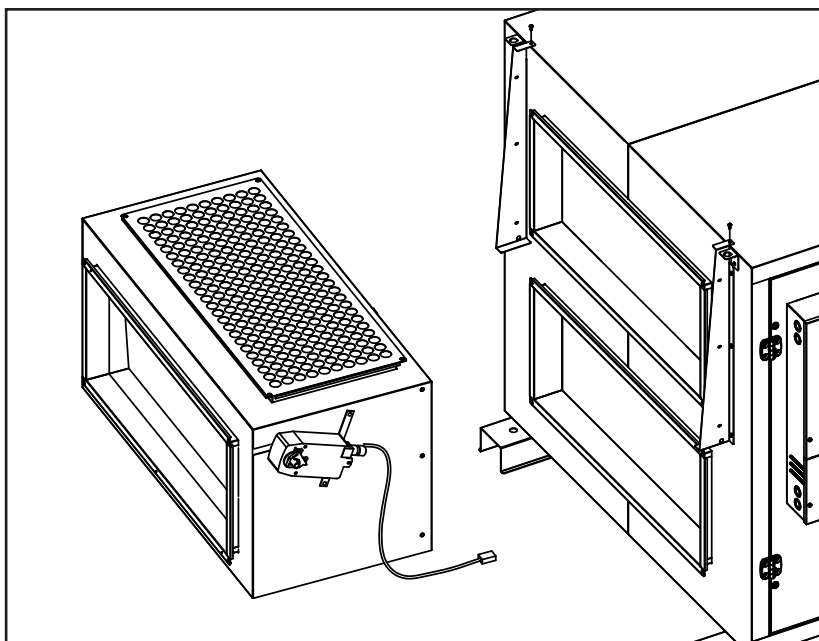


STEP 2

Install the BMP

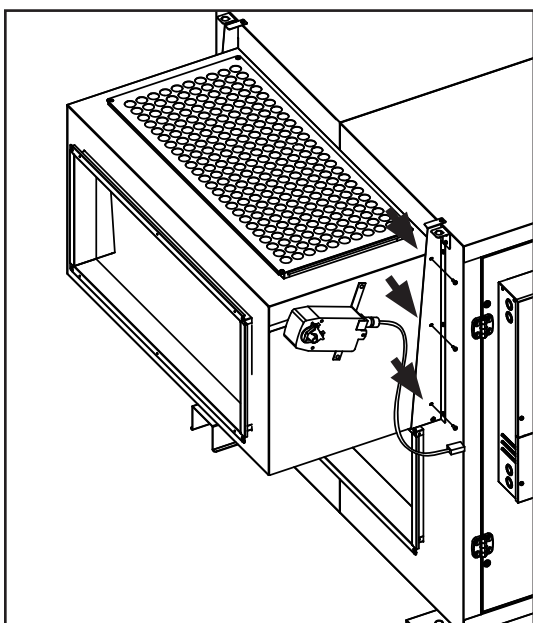

STEP 3

Secure both sides of the BPM to the unit using the 10-32 machine screws.

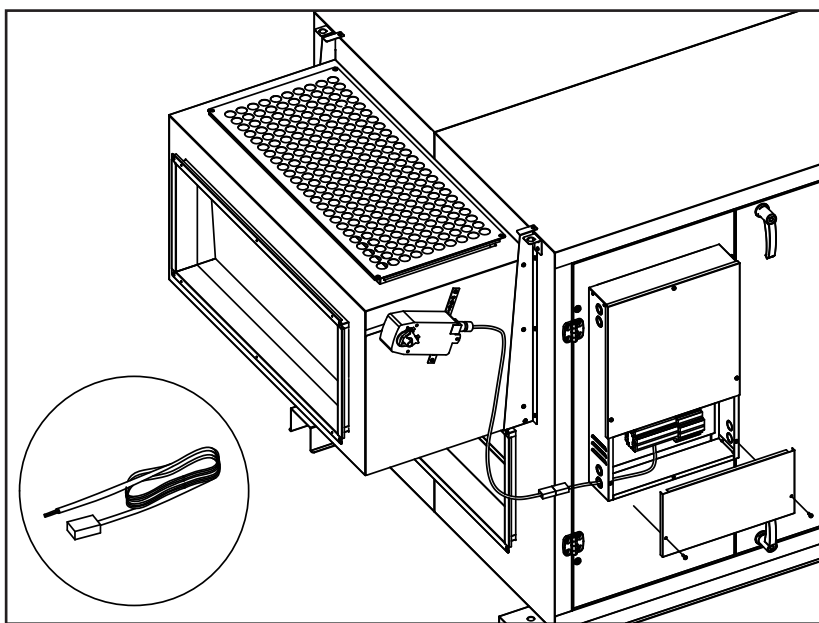

STEP 4

Connect the BPM to the unit.
A harness extension is provided if needed.

Connect to the terminal bloc
TB3 position 10 and 12